



Building and Safety Division - Public Information

County of Ventura • Resource Management Agency • http://www.ventura.org/rma/build_safe
 Main Office • 800 S. Victoria Ave, Ventura, CA. 93009 • 805-654-2771
 East County Office • 3855-F Alamo St., 2nd Fl. # 2019A, Simi Valley, CA 93065 • 805-582-8064


BURIAL DEPTHS FOR YARD PIPING AND ELECTRICAL LINES

These burial depths apply outside of buildings within private property subject to the following provisions:

- Not applicable to utility companies gas and electric utility lines.
- May be laid **in the same trench** without horizontal separation except as noted for sewer and water lines.
- Does not apply to automatic sprinkler system lines beyond control valves.
- **If excavation is proposed under a tree**, contact Planning at (805) 654-2488

SYMBOLS:

- CONDUIT
- PIPE
- () ALTERNATE LOCATION
- ▬ DIRECT BURIAL CABLE

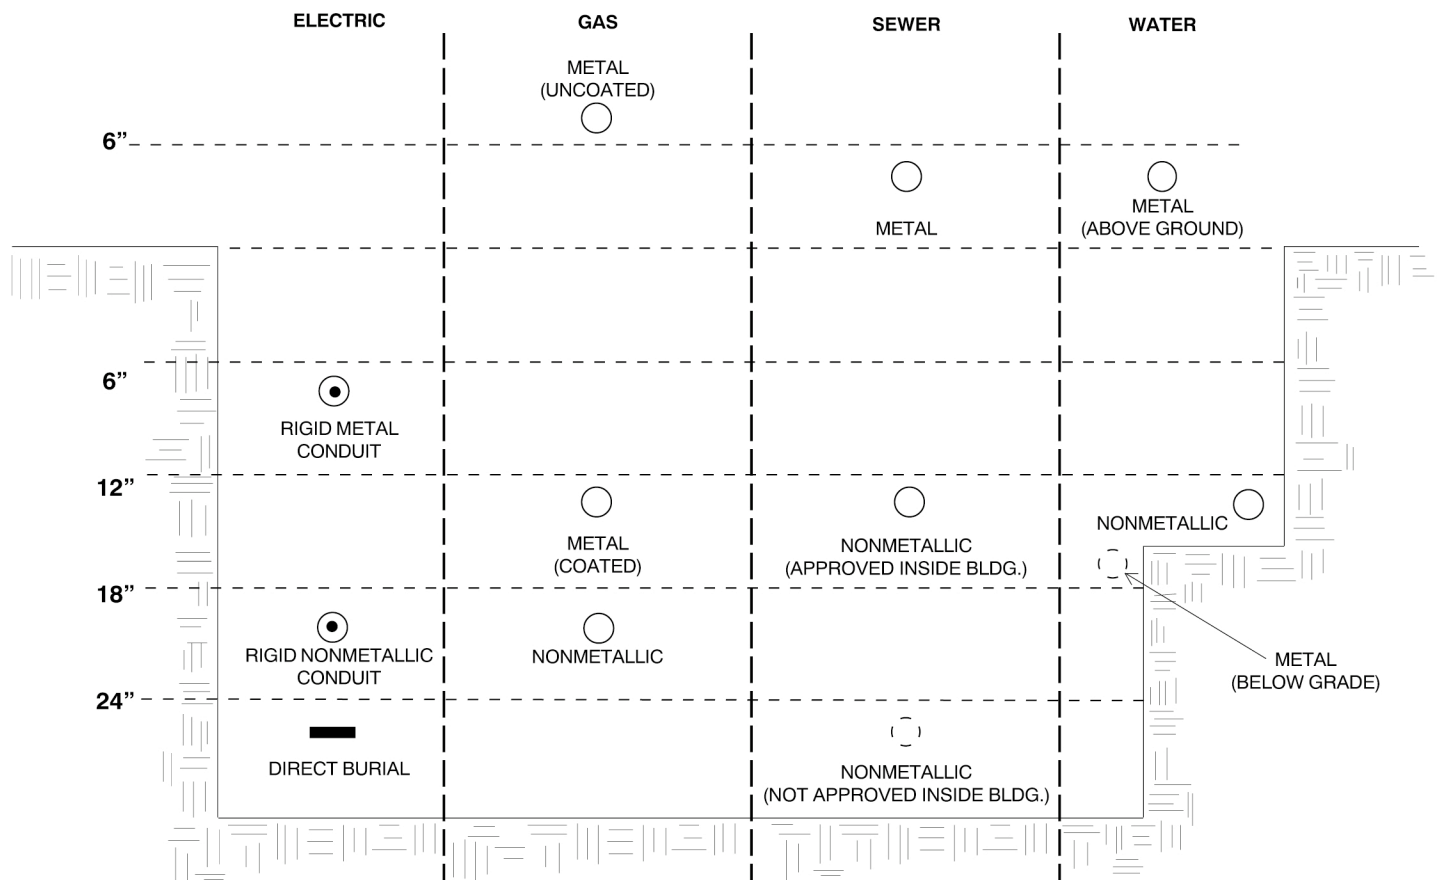

CEC 2007 Sec 300.5

Rigid Metallic - 6"

Rigid Nonmetallic - 18"

Direct Burial - 24"

NOTE: Depth may be reduced by 6" for nonmetallic and direct burial under 2" of concrete. See table 300.5 for additional requirements.

CPC Sec 1211.0

Metal -
 (a) 6" above ground (uncoated and unwrapped).
 (b) 12" below ground (factory coated or machine wrapped).

Nonmetallic - (PE Plastic)
 18" minimum.

NOTE: Require approved plastic-to-metal transition fittings to rise above ground. Also, 14 GA. copper tracer wire required for nonmetallic pipe.

CPC 2007 Sec 720

Metal -
 No burial requirement (recommended 12" to protect from mechanical damage and freezing).

Nonmetallic -
 (a) Pipe approved inside building - 12" minimum.
 (b) Pipe not approved inside building - sewer to be 12" below water line with water pipe 12" to one side on a solid shelf - total depth 24", and 12" apart horizontally minimum.

CPC 2007 Sec 609.0

Metal -
 At or above grade, or 12" minimum below grade.

Nonmetallic -
 12" minimum (plastic).

DIVISION OF BUILDING AND SAFETY
 COUNTY OF VENTURA

BUILDING OFFICIAL

Jim MacDonald, CBO

B & S
 STD

Revised

P-12
 Sheet 1 of 1

May 2009